

**CITY AND BOROUGH OF WRANGELL, ALASKA
REQUEST FOR QUOTES
PUBLIC SAFETY BUILDING – OIL-FIRED BOILER INSTALLATION PROJECT
ADDENDUM TO THE PROJECT DOCUMENTS**

Addendum No:	3	Current RFQ Submittal Date
Addendum Date:	March 21, 2019	March 22, 2019 at 2:00 PM

Pages This Addendum: Three (3), including drawing and photo attachments

Previous Addenda: Two


To: All Proposers

The following corrections, changes, additions, deletions, revisions and/or clarifications are hereby made a part of the Documents for the RFQ for the Public Safety Building – Oil-Fired Boiler Installation. In case of conflicts between this Addendum and previously issued documents, this Addendum shall take precedence. Acknowledge receipt of this Addendum in the space provided on the Quote Form. Failure to do so may subject the Proposer to disqualification.


MECHANICAL DRAWING M1.0

Replace the original Sheet M1.0 dated June 2017 with attached M1.0 June 2017 with **3/21/2019 REVISION** note and its accompanying photo page showing the existing heat piping conditions.

END OF ADDENDUM NO. 3

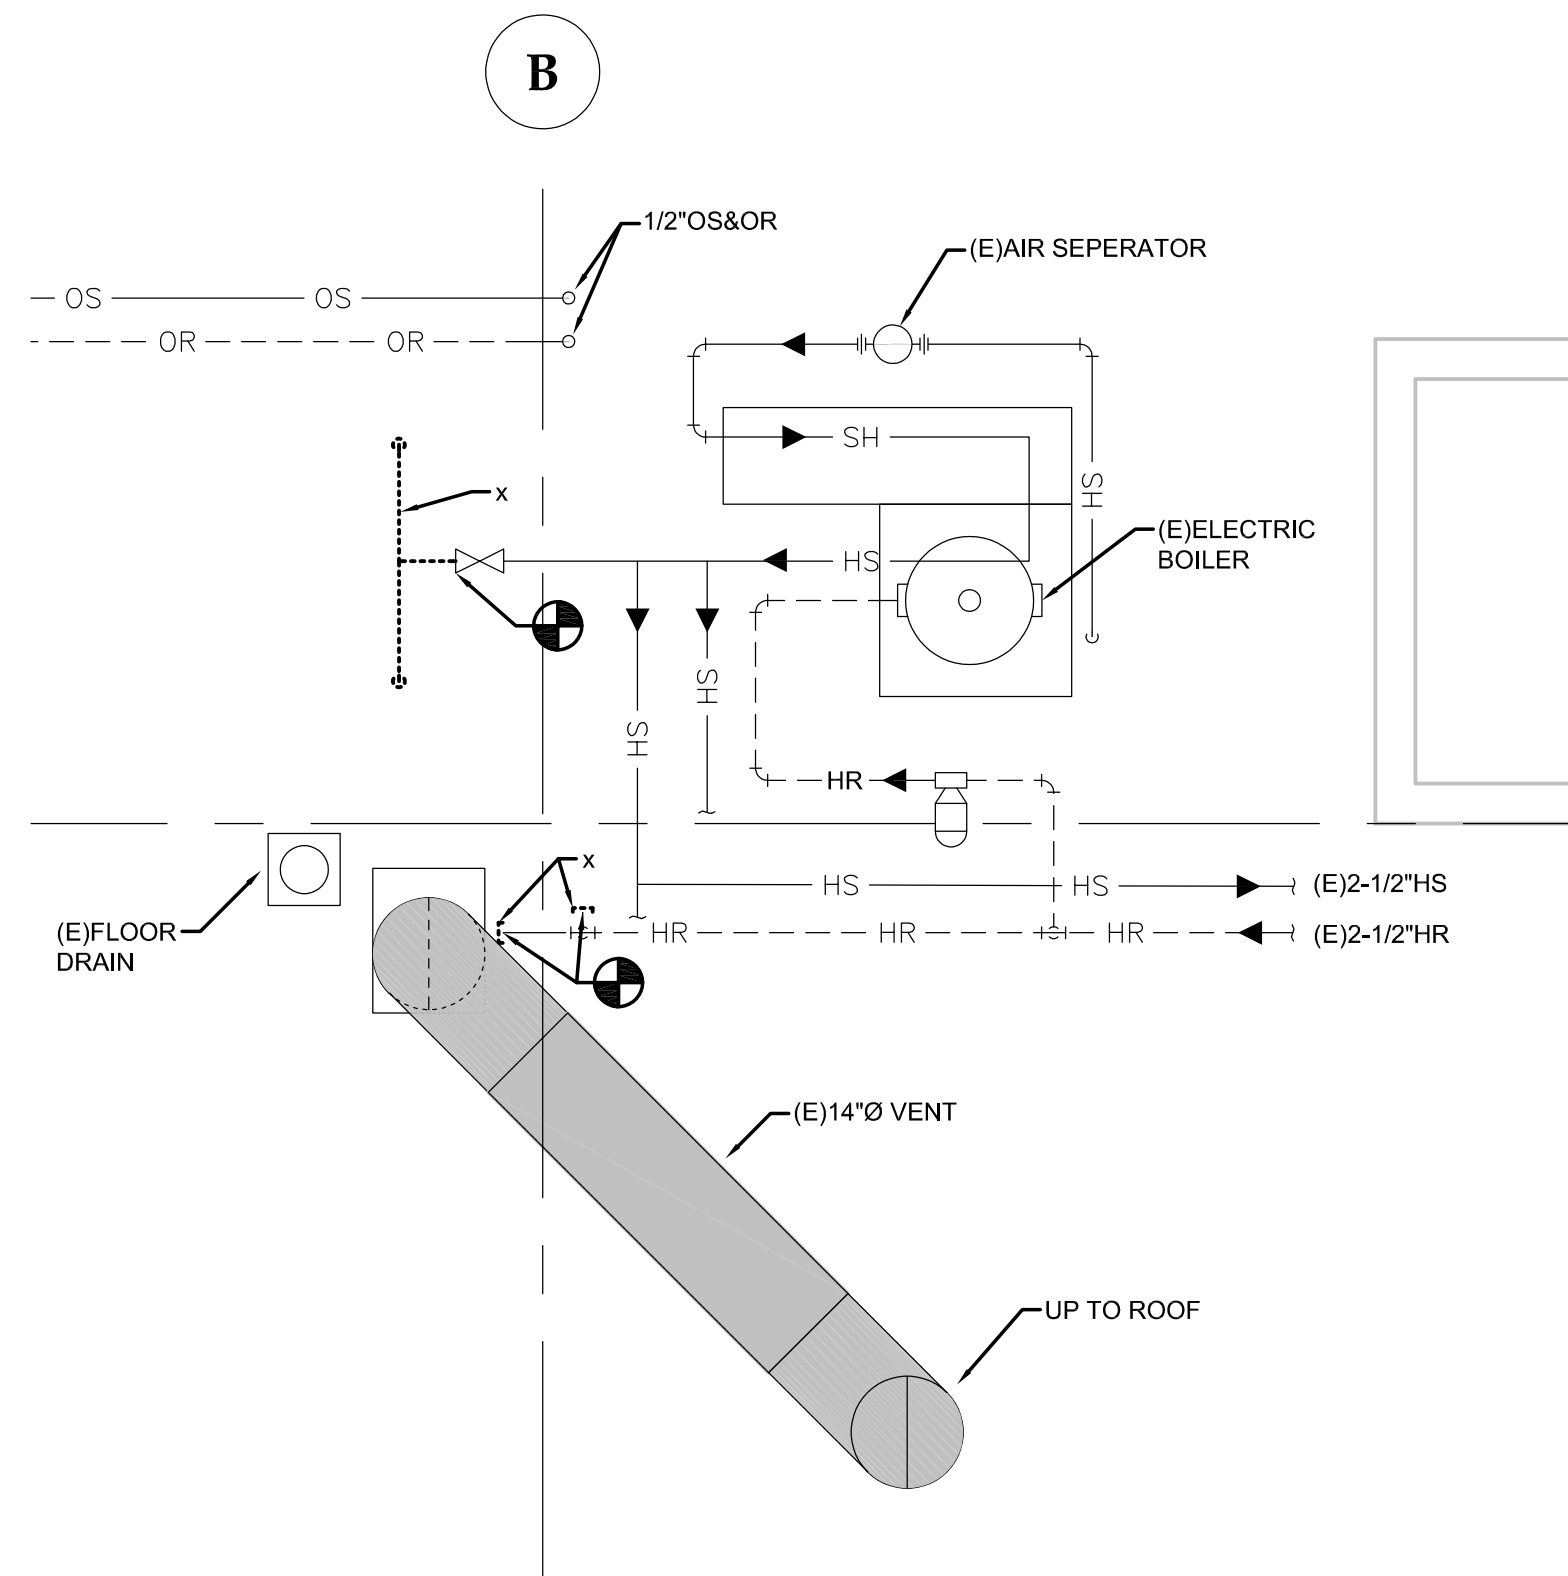


1 FLOOR PLAN - DEMOLITION
SCALE: 0 1' 2' 4'




CONSTRUCTION NOTES:

- 1 OWNER SUPPLIED, CONTRACTOR INSTALLED WEIL-MCLAIN OIL FIRED BOILER.
- 2 EXISTING 14"Ø EXHAUST VENT. REPLACE DOUBLE WALL "TEE" TO MATCH NEW BOILER SIZE AND ELEVATION.
- 3 CONNECT 1/2"ØS FOR LINES TO NEW BURNER.
- 4 MODIFY PIPING TO ACCOMMODATE A PRIMARY/SECONDARY LOOP SYSTEM FOR HEATING HOT WATER.
- 5 REMOVE DAMPER ON COMBUSTION AIR.
- 6 SELECT AND INSTALL A NEW PRIMARY CIRCULATOR PUMP FOR THE NEW OIL FIRED BOILER.
- 7 INSTALL DIELECTRIC UNION IN PIPING.

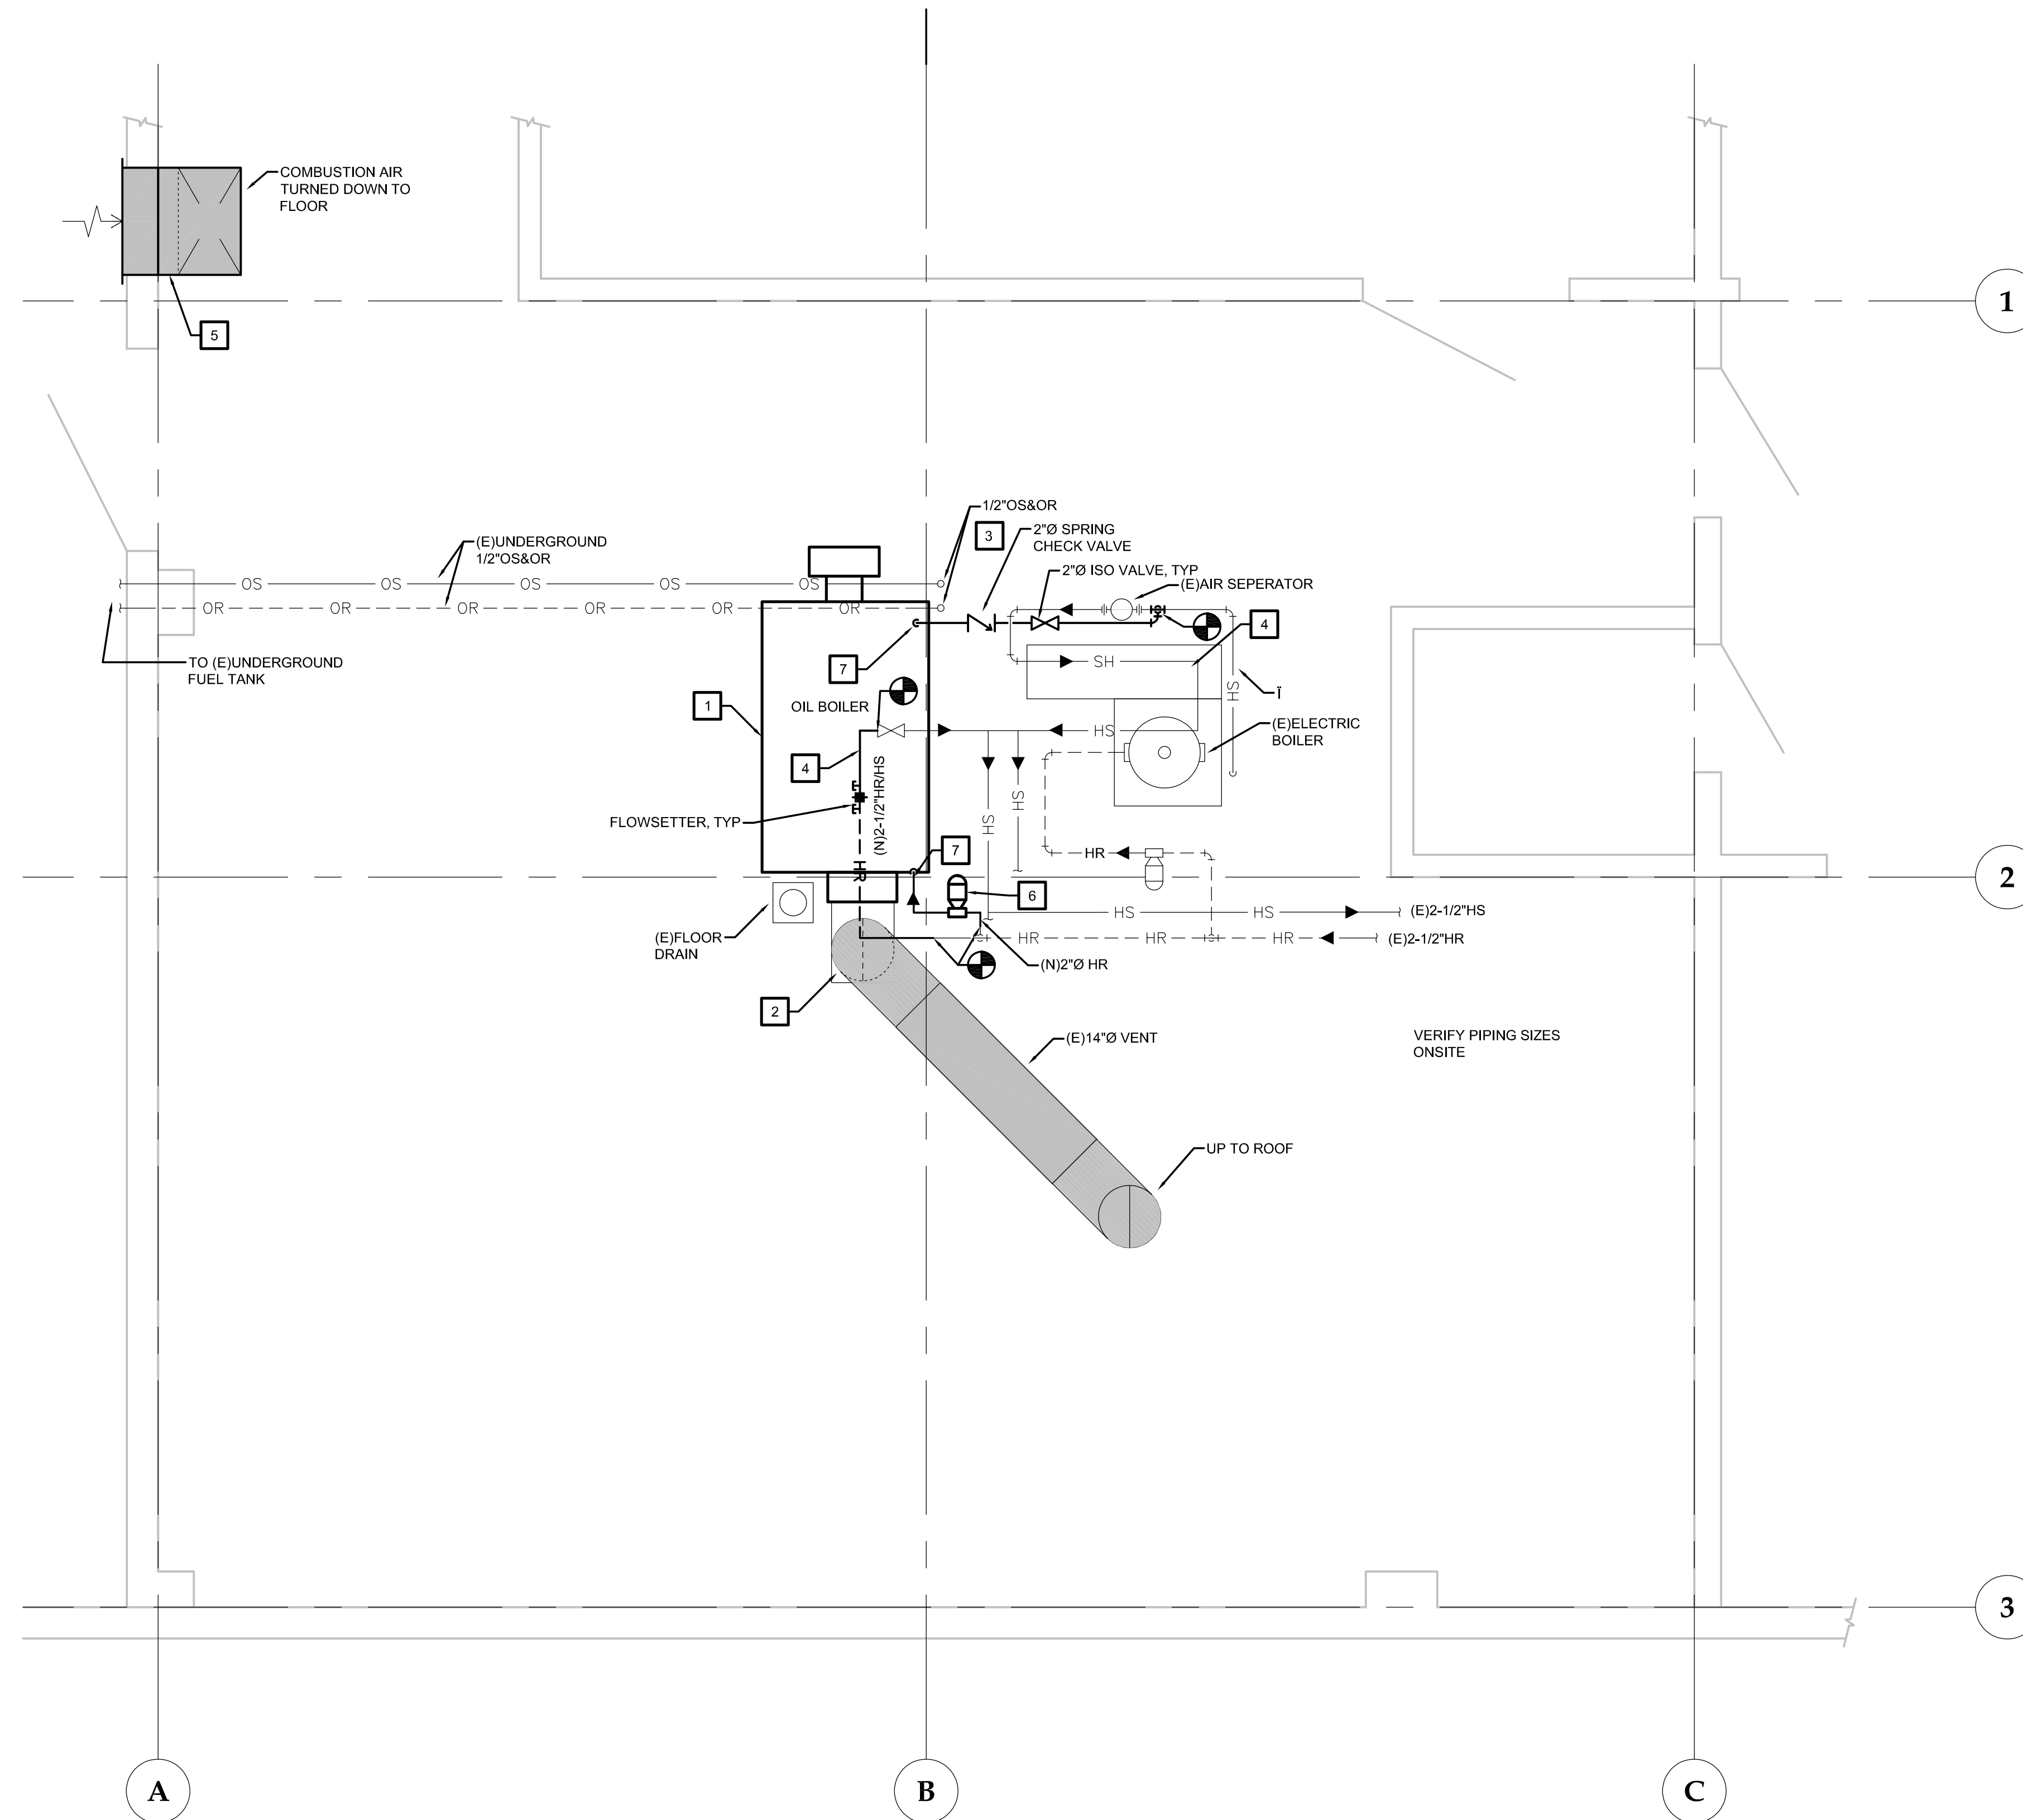


2 FLOOR PLAN - RENOVATION
SCALE: 0 1' 2' 4'



3/21/2019 REVISION

DESIGN	AM
DRAWN	KB
CHECKED	DM
DATE	JUNE 2017
PROJECT No. 17160JM/M-566	
SHEET NUMBER M1.0	
M1 OF X SHEETS	

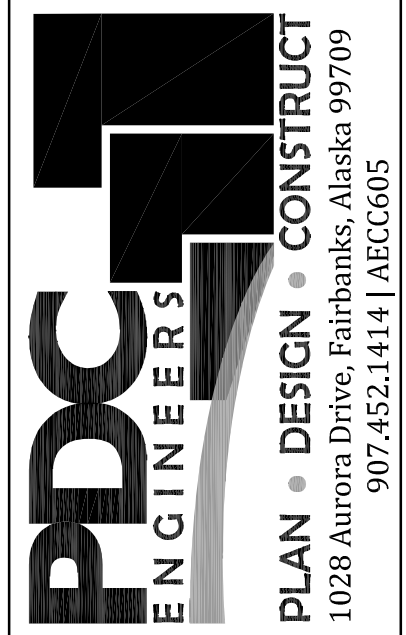

PROJECT:
WRANGELL PUBLIC SAFETY PIPING REPLACEMENT
WRANGELL, ALASKA

SHEET TITLE:
FLOOR PLAN

P:\2017\17160JM\M-566\FloorPlan.dwg, 3/21/2019 10:02 AM

Addendum 3 – Public safety Building Oil-Fired Boiler Installation (Wrangell, Alaska)

